

Do not cover luminaire or driver with thermally insulating material (A). It is recommended to allow a minimum of 50 mm clearance above the luminaire as seen in (B).

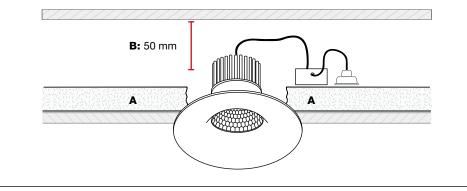


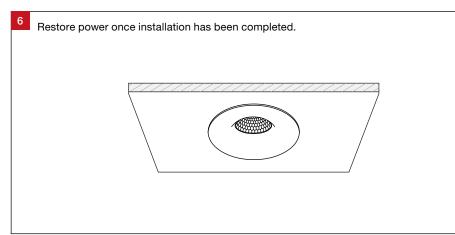

V1-15.02.2024 Product designs and technical data may be subject to change

Platinum P12K Recessed Downlight

Installation Guide

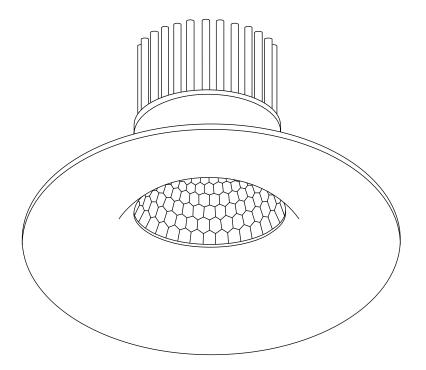



Platinum P12K

5

Trend Lighting Co. Pty Ltd



For warranty information, please visit


trendlighting.com.au/warranty

Important Safety Information

Please read these installation instructions carefully before installing this luminaire.


- This product must be installed by a licensed electrician in accordance with AS/NZS 3000 and local regulations.
- Isolate the mains power supply prior to installation.
- Only reconnect mains power after installation is completed.
- No part of the luminaire should be altered or modified.
- This product is not user serviceable.


² Mark at the correct location. Cut a hole in the ceiling in accordance with cutout size. P12K ceiling cutout: **76-92 mm**

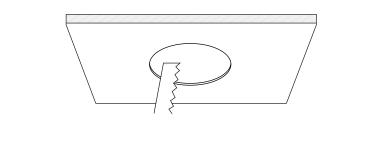


Approvals

The RCM marking of this product applies to AS/NZS 4417.1 "Regulatory compliance mark (RCM) for electrical and electronic equipment". This product is designed to conform to AS/NZS 60598 "Luminaires, general requirements and tests".



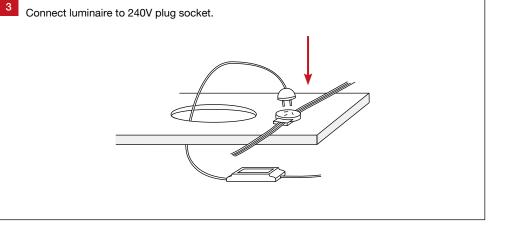

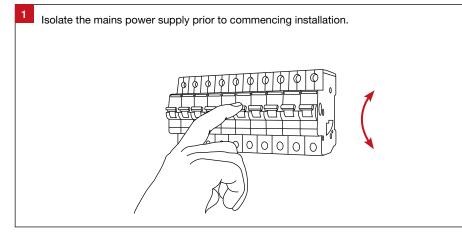

Lift the springs upward to install the luminaire into the mounting hole.

